

Performance Evaluation and Improvement of Boiler Efficiency

G.V.Nagamani¹, N. Jashuva²

¹Associate Professor & Head , Department of Mechanical Engineering, Global College of Engineering, Science & Technology, Kadapa, A.P., India.

²M.Tech, Department of Mechanical Engineering, Global College of Engineering Kadapa, A.P., India

ABSTRACT: performance preventive measures for corrosion of heating elements has been studied, and also air heater leakage, corrected gas outlet temperature and finally gas efficiency has been calculated .Air pre-heater is a heat transfer surface in which air temperature is raised by transferring heat from other media such as flue gas .Hot air is necessary for rapid combustion in the furnace and also for drying coal in milling plants. So an essential boiler accessory which serves this purpose is air pre-heater. The air pre-heater are not essential for operation of steam generator, but they are used where a study of cost indicates that money can be saved or efficient combustion can be obtained by their use. The decision for its adoption can be made when the financial advantages is weighed against the capital cost of heater in the present paper we have taken up the operation and performance analysis of LJUNGSTROM AIRPREHEATER27VITM 1900 of 2x210 MW capacity Rayalaseema Thermal Power Plant, Kalamala and compare with Rothemuhle air pre-heater.

KEYWORDS: Thermal power plant, energy, air pre heater, Rothemuhle air pre-heater

1. INTRODUCTION

The place where the heat energy of fuel is converted into Electrical Energy is called Thermal Power Plant.

Energy Conversion: This part of the lesson outlines the various conversion processes which are carried out at power station indicating where possible the efficiency of the conversion process or in other words, indicating how successful the operation is of converting one form of energy into another. Remember, energy cannot be destroyed, but its conversion incurs difficulties, which results in not all the energy being usefully converted

Chemical Energy to Heat Energy: Chemical energy is stored in coal is converted into heat by the process known as combustion. The carbon and other combustible elements in coal are made to unite with Oxygen of air in furnaces. This process converts chemical energy into heat energy. Many pieces of equipment are used for this first conversion, including chain grate stroke, pulverized fuel furnaces, forced and induced draught fans, chimney stacks and many other items of boiler house plant.

II. WORKING PRINCIPLE

As the name implies the tri-sector pre-heater design has three sections. Use for flue gas. One for primary air (used for drying and transport of coal through mill to the burner) another for secondary air (additional air for combustion around the burners). These helps in avoiding wastage of heat pick up by air due to primary air flow and also help in selecting different temperatures for primary air and secondary air. Whatever is not utilized in primary air can be picked up by secondary air stream. Thousands of these high efficiency elements are spaced compactly arranged with in 12 sectors shaped compartments for heater size from 24.2 to 27 inches, and 24 sector shaped compartments for heater size from 28 to 33 of radially divided cylindrical shell called the rotor. The housing surrounding the rotor is provided with duct

connections at both ends and is adequately sealed by radial and axial sealing members forming an air passage through one half of the pre-heater and a gas passage through the other. As the rotor slowly revolves the mass of the elements alternatively through the air and gas passage, heat is absorbed by the element surfaces passing through the hot gas stream. These are the same surfaces are carried through the air stream. They released the stored up heat thus increasing the temperature of the incoming combustion or process air.

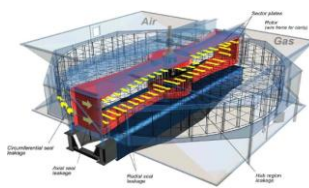


Figure 1: 3-D View of Ljungstrom Air pre-heater

The Ljungstrom air pre-heater is more widely used than any other type of heat exchanger for comparable service. The reasons for this world wide acceptance are its proven performance and reliability, effective leakage control, and its adaptability to most, any fuel burning process. It is both designed and built to operate over extend periods with durable, uninterrupted service. Simplicity of design also makes it easy and economical to maintain while in operation and at scheduled outages.

Applications of Air Pre-Heaters: Available in a broad range of sizes, arrangements and materials, LJUNGSTROM Air pre-heaters are custom engineer to meet the specific requirements and operating conditions of a variety of applications.

- Electric power generating plants
- Fluidized bed and marine boilers
- Package and large industrial boilers
- Hydro-carbon and chemical processes
- Flue gas and other re heating systems
- Heat transfer surface

III. IMPROVEMENT IN THERMAL PERFORMANCE

Soft Touch Seal: A new concept has been developed to minimize the seal leak. As an introduction, this 'Soft Touch Seal' is provided for hot end radial seal only. This can be extended to axial seal also. Soft touch seal has flexile end that cannot escape air from one basket to another basket. That can be reduces the percentage of air leak to flue gas. Heat transfer is effectively utilized from flue gas to Primary Air and Secondary Air.

Double Sealing: In double sealing an additional radial and axial seals are introduced along with the existing seals. This will reduce the overall leakage y 1.5% to 2% recently even triple seals have been introduced.

Double Sealing is adapted in the recent design. For old air pre-heaters, this can be retrofitted. This modification will call for the change of all baskets dimensions



Figure 2: Incorporation of soft touch seal Figure 3: View of soft touch seal Diaphragm Plate Protection

Sheets: In the conventional air pre-heater, the hot end of the diaphragm plate is exposed to the gas flow. Due to erosive ash particles, the diaphragm plate edges erode fast. In course of time, the erosion extends to the radial seal fixing hole, thereby distributing the fixing and setting of radial seals. The diaphragm plate edge can be protected by the erosive resistant cover plates with the change of seals, these protective sheets also can be changed.

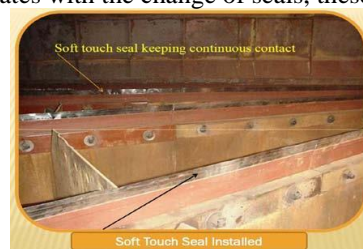


Figure 4: Installation of soft touch seal

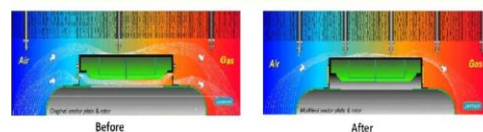


Figure 5: Before and After sealing

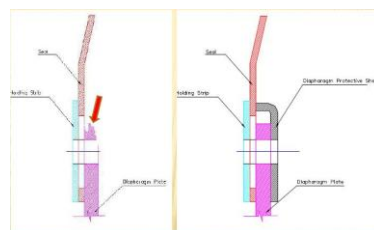


Figure 6: Insertion of diaphragm protection sheets

Cast 'T' Bar: Currently rolled 'T' bars are used for bypass sealing. This rolled 'T' has more variation in the radius.

After setting it gives more leakage through bypass seal. Whatever correction is made at site could not control the radius variations. The cast 'T' bars keep the radius with controlled dimension, thus reducing the leakage across bypass seals.



Figure 7: Reducing gaps by casted T-Bars

can be changed to 0.8 mm DU profile. This will increase the heat transfer area, thereby reducing the flue as outlet temperature. It is calculated that by changing the profile as suggested, the as outlet temperature will decrease by 4⁰C, that means 0.2% improvement in efficiency. This change has already been incorporated in the current design. Still some of the air pre-heaters are operating with cold end NF6 profile. This can be changed.

New Profiles: A highly efficient element profiles are available to improve the thermal performance. Case Study-I is presented to show the performance changes with the introduction of new profiles. With the introduction of new profile, the gas outlet temperature can be achieved to 135.6⁰C.

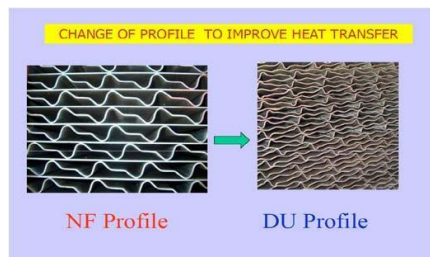


Figure 8: Change of profiles

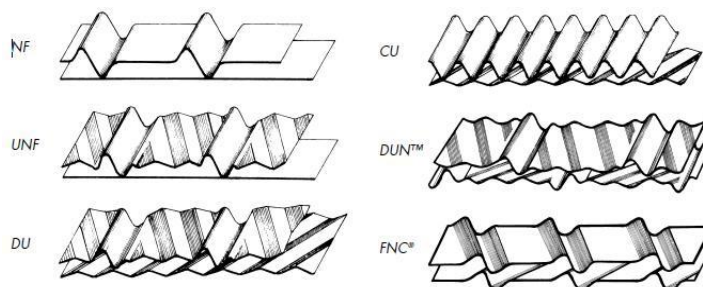


Figure 9: New profiles

IV. OVERHAULING OF THE PLANT AFTER INCORPORATING SOFT SEALS:

OVERHAUL PERIOD - (15/11/2012 - 15/12/2012)						
S.No.	PARAMETERSUNITS		BEFORE OVERHAUL		AFTER OVERHAUL	
			APH-A	APH-B	APH-A	APH-B
1.	UNITLOAD	MW	205	-	210	-
2.	Fuel consumption	T/hr	115.3	-	113	-
3.	PD fan current	amps	198	178	181	188
4.	FD fan current	amps	171	164	157	141
5.	ID fan current	amps	278	311	236	238

4.1 Profits Gained After Overhauling

A) Cost saving per hour:

1. Fuel saving = 115.3 - 113 = 2.3 T/Hr
2. Assuming coal cost as = Rs 2000 per MT
3. Cost saving per hour = 2000 X 2.3 = Rs 4600
4. Cost of fuel saving per year = 4600X24X365 = Rs 40, 29,600

B) Cost benefit due to fan loading:

1. Total fan loading before overhauling = 1300 amps
2. Total fan loading after overhauling = 1141 amps
3. Total saving in current = 159 amps
4. Power saved = 1.73 X 3.3 X 159 X 0.86
= 782.00KW hr = 0.782MWhr
5. Energy saved per year = 6,850,320
6. Power cost = Rs 2.60 per unit
7. Saving per year = 6850320 X 2.60 = Rs 1,78,10,832

- C) Total savings per year** = 4,02,96,000 + 1,78,10,832
= Rs 5,81,06,832

V. COMPARING LJUNGSTROM WITH ROTHEMUHLE

Calculations of Ljungstrom air pre-heater

The method determines air pre-heater as per this procedure is the volumetric method this is an empirical approximation of air heaters leakage with an accuracy of + / - 1%.

$$AL = \frac{(O_2^{gl} - O_2^{ge})}{21 - O_2^{gl}} \times 0.9 \times 100$$

Collected Data:

AL – Air heater leakage

O_{2gl} – Percentage of O₂ in gas entering air heater: 3.5

O_{2ge} – Percentage of O₂ in as leaving air heater: 5.0

Secondary air (SA) leaving air heater = 299⁰c

Primary air (PA) leaving air heater = 304⁰c

Calculations:

$$\text{Air leakage } AL = \frac{(5.0 - 3.5)}{21 - 5.0} \times 0.9 \times 100 = 8.437 \%$$

Gas Side Efficiency:

The gas efficiency is defined as the ratio of the temperature drop. Corrected leakage to the temperature head, expressed as a percentage. Temperature drop is obtained by subtracting the corrected gas outlet temperature from the gas inlet temperature. Temperature head is obtained by subtracting air inlet temperature from the gas inlet temperature. The corrected gas outlet temperature is defined as outlet gas temperature calculated for ‘no air heater leakage’ and is given by following equation.

$$T_{gnl} = T_{gl} - AL \times C_{pa} \frac{(T_{gl} - T_{ae})}{(100 \times C_{pg})}$$

Collected Data:

T_{gnl} – Gas outlet temperature corrected for no leakage.

C_{pa} – The mean specific heat between temperature T_{ae} and T_{gl} = 1.023 KJ / kg⁰k C_{pg} - The mean specific heat between temperature T_{gl} and T_{ae} = 1.109 KJ / kg⁰k T_{ae} – Temperature of air entering air heater = 40⁰c

T_{ge} – Temperature of gas entering air heater = 331⁰c T_{gl} – Temperature of gas leaving air heater = 154⁰c

International Journal of Innovative Research in Science, Engineering and Technology

An ISO 3297: 2007 Certified Organization

Volume 4, Special Issue 11, September 2015

National Conference on Emerging Trends in Computing, Communication & Control Engineering [NCET 2K15]

On 4th September, 2015

Organized by

Department of CSE, ECE & EEE, Magna College of Engineering, Chennai-600055, India.

X- Ratio: Ratio of heat capacity of air passing through the air heater to the heat capacity of flue gas passing through the air heater.

$$X\text{-Ratio } (X_r) = \text{Gas Side Efficiency} / \text{Air Side Efficiency}$$

Air Side Efficiency (SA & PA): Ratio of air temperature gain across the air heater corrected from no leakage to the temperature head.

$$\text{Air Side Efficiency} = \frac{(T_{al} - T_{ae})}{(T_{ge} - T_{ae})} \times 100$$

Collected Data:

T_{ae} – Temperature of air entering air heater = 40⁰c

T_{al} – Temperature of air leaving air heater = 302⁰c

T_{ge} – Temperature of gas entering air heater = 331⁰c

Calculations:

$$\text{Air Side Efficiency} = \frac{(T_{al} - T_{ae})}{(T_{ge} - T_{ae})} \times 100 = \frac{(302 - 40)}{(331 - 40)} \times 100 = 90.03\%$$

$$X\text{-Ratio } (X_r) = \text{Gas Side Efficiency} / \text{Air Side Efficiency} \quad X_r = \frac{57.77}{90.03} = 0.641$$

$$\begin{aligned} \text{Gas leaving temperature without leakage } T_{gl} &= T_{ge} - X_r (T_{al} - T_{ae}) \\ &= 331 - 0.641 (302 - 40) = 163.05^0\text{c} \end{aligned}$$

Pre heater Air side efficiency (SA & PA):

$$\text{Air side efficiency (SA \& PA)} = \frac{(T_{ge} - T_{ae})}{(T_{ge} - T_{ae})} \times 100 = \frac{(331 - 163.05)}{(331 - 40)} \times 100 = 57.71\%$$

VI. CONCLUSIONS

- The Thermal performance of the air preheater is improved
- Load on the fans are reduced thus power consumption is reduced and cost is reduced
- Fuel consumption is also reduced, thus fuel is saved and cost is reduced
- By comparing Rothemuhle with Ljungstrom air leakages are more, gas side efficiency and air side efficiencies are less in Rothemuhle air pre-heater
- The Thermal performance of the Ljungstrom air pre-heater is better than Rothemuhle

REFERENCES

1. Driscoll, J.M. et. al, "ASME Performance Test Codes Test Code for Air Heaters", USA, 1968.
2. Hewitt, G.F., Shires, G.L. and Bott, T.R., "Process Heat Transfer", Boca Raton, CRC Press, USA, 1994.
3. Incropera, F.P. and Dewitt, D.P., "Introduction to Heat Transfer", 4th edition, John Wiley & Sons Inc., USA, 2002.
4. Shah, R.K., Sekulic, D.P., "Fundamentals of Heat Exchanger Design", John Wiley & Sons Inc., Canada, 2003.
5. Juangjandee, P. and Sucharitakul, T., "Performance Evaluation of Cross-Flow Heat Exchanger in Coal-Fired Power Plant under Particulate Condition", 18th Conference of Mechanical Engineering Network of Thailand, Khon Kaen University, Thailand, 2004.
7. Juangjandee, P. and Sucharitakul, T., "Performance Evaluation of Leakage Cross-Flow Heat Exchanger in Coal-Fired Power Plant", 19th Conference of Mechanical Engineering Network of Thailand, Phuket, Thailand, 2005.
9. Juangjandee, P. and Sucharitakul, T., "Effect of High Ash Content Lignite on Cross-Flow Heat Exchanger Performance in Mae Moh Lignite-Fired Power Plant", HAPUA Fuel Procurement & Utilisation Forum, Kuala Lumpur, Malaysia, 2006.
10. Juangjandee, P. and Sucharitakul, T., "Air Heater Performance and Enhancement under Low-Rank Coal", 16th Conference of Electric Power Supply Industry, Mumbai, India, 2006.