

Combined Analysis of Phase Resolved Partial Discharge Patterns using Statistical Techniques

Kajol Kothoke¹, P. A. Ghonge²

P.G. Student, Department of Electrical Engineering, Yadavrao Tasgaonkar Institute of Engineering
And Technology, Maharashtra, India¹

Associate Professor, Department of Electrical Engineering, Yadavrao Tasgaonkar Institute of Engineering
And Technology, Maharashtra, India²

ABSTRACT: Partial discharges (PDs) in high-voltage (HV) insulating systems originate from various local defects, which further results in degradation of insulation and reduction in life span of equipment. One of the most widely used representations is phase-resolved PD (PRPD) patterns. For reliable operation of HV equipment, it is important to observe statistical characteristics of PDs and identify the properties of defect to ultimately determine the type of the defect. In this work, we have obtained and analysed combined use of PRPD patterns (ϕ -q), (ϕ -n) and (n-q) using statistical parameters such as skewness and kurtosis for (ϕ -q) and (ϕ -n), and mean, standard deviation, variance, skewness and kurtosis for (n-q).

KEYWORDS: Kurtosis, Partial Discharge, Phase- Resolved, Skewness and Statistical Techniques

I. INTRODUCTION

PD is an incomplete electrical discharge that occurs between insulation or insulation and a conductor. Partial discharges occur wherever the electrical field is higher than the breakdown field of an insulating medium. There are two necessary conditions for a partial discharge to occur in a cavity: first, presence of a starting electron to initiate an avalanche and second, the electrical field must be higher than the ionization inception field of the insulating medium [1]. In general, PDs are concerned with dielectric materials used, and partially bridging the electrodes between which the voltage is applied. The insulation may consist of solid, liquid, or gaseous materials, or any combination of them. PD is the main reason for the electrical ageing and insulation breakdown of high voltage electrical apparatus. Different sources of PD give different effect on insulation performance. The occurrence of sparks, arcs and electrical discharges is a sure indication that insulation problems exist. Therefore, PD classification is important in order to evaluate the harmfulness of the discharge [11]. PD classification aims at the recognition of discharges of unknown origin. For many years, the process was performed by investigating the pattern of the discharge using the well known ellipse on an oscilloscope screen, which was observed crudely by eye. Nowadays, there has been extensive published research to identify PD sources by using intelligent technique like artificial neural networks, fuzzy logic, and acoustic emission [11]. There seems to be an expectation that, with sufficiently sophisticated digital processing techniques, it should be possible not only to gain new insight into the physical and chemical basis of PD phenomena, but also to define PD 'patterns' that can be used for identifying the characteristics of the insulation 'defects' at which the observed PD occur [2]. Broadly, there are three different categories of PD pulse data patterns gathered from the digital PD detectors during the experiments. They are: phase-resolved data, time-resolved data and data having neither phase nor time information. The phase-resolved data consist of three-dimensional discharge epoch, ϕ charge transfer, q discharge rate, n patterns (ϕ -q, q~n and ϕ -n patterns) at some specific test voltage. The time-resolved data constitute the individual discharge pulse magnitudes over some interval of time, i.e., q~t data pattern. The third category of data consists of

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

variations in discharge pulse magnitudes against the amplitude of the test voltage, V (for both increasing and decreasing levels), i.e., $q \sim V$ data [3].

There are many types of patterns that can be used for PD source identification. If these differences can be presented in terms of statistical parameters, identification of the defect type from the observed PD pattern may be possible [4]. As each defect has its own particular degradation mechanism, it is important to know the correlation between discharge patterns and the kind of defect. Therefore, progress in the recognition of internal discharge and their correlation with the kind of defect is becoming increasingly important in the quality control in insulating systems [5]. Researches have been carried out in recognition of partial discharge sources using statistical techniques and neural network. In our study, we have tested various internal and external discharges like void, surface and corona using statistical parameters such as skewness and kurtosis for $(\varphi-q)$ and $(\varphi-n)$ and mean, standard deviation, variance, skewness and kurtosis for $(n-q)$.

II. STATISTICAL PARAMETERS

The important parameters to characterize PDs are phase angle φ , PD charge magnitude q and PD number of pulses n . PD distribution patterns are composed of these three parameters. Statistical parameters are obtained for phase resolved patterns $(\varphi-q)$, $(\varphi-n)$ and $(n-q)$.

II.I. Processing of data

The data to be processed obtained from generator includes φ , q , n and voltage V . From this data, phase resolved patterns are obtained.

II.I.A Analysis of Phase-Resolved $(\varphi-q)$ and $(\varphi-n)$ using Statistical Techniques

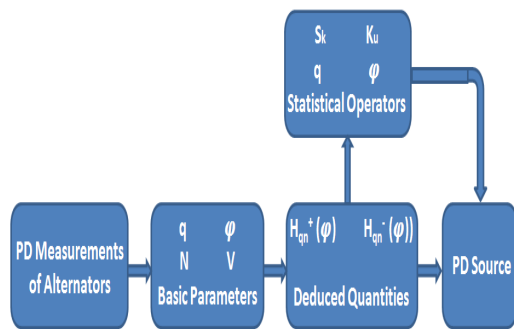


Fig.1 (a) Block diagram of discharge analysis for $(\varphi-q)$

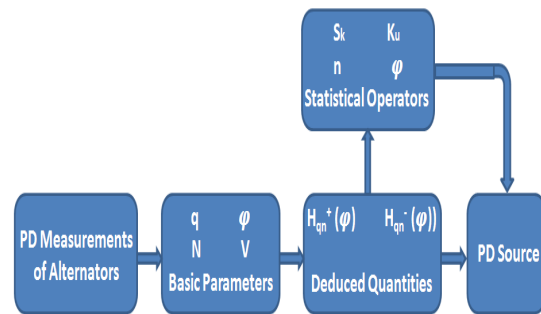


Fig.1 (a) Block diagram of discharge analysis for $(\varphi-n)$

PD pulses are grouped by their phase angle with respect to $50 (\pm 5)$ Hz sine wave. Consequently, the voltage cycle is divided into phase windows representing the phase angle axis (0 to 360°). If the observations are made for several voltage cycles, the statistical distribution of individual PD events can be determined in each phase window. The mean values of these statistical distributions results in two dimensional patterns of the observed PD patterns throughout the whole phase angle axis [6]. A two-dimensional (2D) distribution $\varphi-q$ and $\varphi-n$ represents PD charge magnitude 'q' and PD number of pulses 'n' as a function of the phase angle 'phi' [3].

The mean pulse height distribution $H_{qn}(\varphi)$ is the average PD charge magnitude in each window as a function of the phase angle φ . The pulse count distribution $H_n(\varphi)$ is the number of PD pulses in each window as a function of phase angle φ . These two quantity are further divided into two separate distributions of the negative and positive half cycle resulting in four different distributions to appear: for the positive half of the voltage cycle $H_{qn}^+(\varphi)$ and $H_n^+(\varphi)$ and for the negative half of the voltage cycle $H_{qn}^-(\varphi)$ and $H_n^-(\varphi)$ [5]. For a single defect, PD quantities can be described by the normal distribution. The distribution profiles of $H_{qn}(\varphi)$ and $H_n(\varphi)$ have been modeled by the moments of the normal distribution: skewness and kurtosis.

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

$$\text{Skewness } (S_k) = \frac{\sum_{i=1}^N (x_i - \mu)^3 f(x_i)}{\sigma^3 \sum_{i=1}^N f(x_i)} \quad \dots \dots \dots (1)$$

$$\text{Kurtosis: } (K_u) = \frac{\sum_{i=1}^N (x_i - \mu)^4 f(x_i)}{\sigma^4 \sum_{i=1}^N f(x_i)} - 3 \quad \dots \dots \dots (2)$$

Skewness and Kurtosis are evaluated with respect to a reference normal distribution. Skewness is a measure of asymmetry or degree of tilt of the data with respect to normal distribution. If the distribution is symmetric, $S_k=0$; if it is asymmetric to the left, $S_k>0$; and if it is asymmetric to the right, $S_k<0$. Kurtosis is an indicator of sharpness of distribution. If the distribution has same sharpness as a normal distribution, then $K_u=0$. If it is sharper than normal, $K_u>0$, and if it is flatter, $K_u<0$ [3] [7].

III.B Analysis of Phase-Resolved ($q-n$) using Statistical Techniques

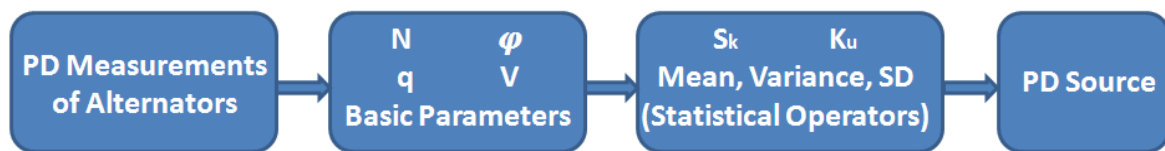


Fig. 2 Block diagram of discharge analysis for ($n-q$)

Statistical analysis is applied for the computation of several statistical operators. The definitions of most of these statistical operators are described below. The profile of all these discrete distribution functions can be put in a general function, i.e., $y_i=f(x_i)$. The statistical operators can be computed as follows:

$$\text{Mean Value: } (\mu) = \frac{\sum_{i=1}^N (x_i) f(x_i)}{\sum_{i=1}^N f(x_i)} \quad \dots \dots \dots (3)$$

$$\text{Variance: } (\sigma^2) = \frac{\sum_{i=1}^N (x_i - \mu)^2 f(x_i)}{\sum_{i=1}^N f(x_i)} \quad \dots \dots \dots (4)$$

$$\text{Standard Deviation} = \sqrt{\text{Variance}} \quad \dots \dots \dots (5)$$

Skewness and Kurtosis are evaluated with respect to a reference normal distribution. Skewness is a measure of asymmetry or degree of tilt of the data with respect to normal distribution. If the distribution is symmetric, $S_k=0$; if it is asymmetric to the left, $S_k>0$; and if it is asymmetric to the right, $S_k<0$. Kurtosis is an indicator of sharpness of distribution. If the distribution has same sharpness as a normal distribution, then $K_u=0$. If it is sharper than normal, $K_u>0$, and if it is flatter, $K_u<0$ [3] [8].

III. RESULTS AND DISCUSSIONS

Analysis involves determining unknown PD patterns by comparing those with known PD patterns such as void, surface and corona. The comparison is done with respect to their statistical parameters [9] [10].

III.I Analysis for ($\phi-q$)

The phase resolved patterns are divided into two types: ($\phi-q$) and ($\phi-n$). The phase resolved patterns ($\phi-q$) are obtained for three known PD patterns: void, surface and corona (as discussed in 3.1.1) and three unknown PD patterns: data1, data2 and data3 (as discussed in 3.1.3) [9]

III.I.A 2D distribution of (ϕ -q) for known PD patterns

Fig.3 (a), Fig.3 (b) and Fig.3 (c) are the phase ϕ vs. charge q plot for void, surface and corona discharges respectively.

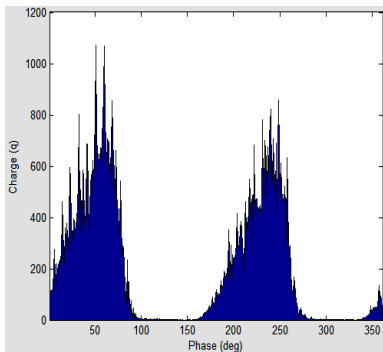


Fig.3(a).Phase plot (ϕ -q) of void discharge

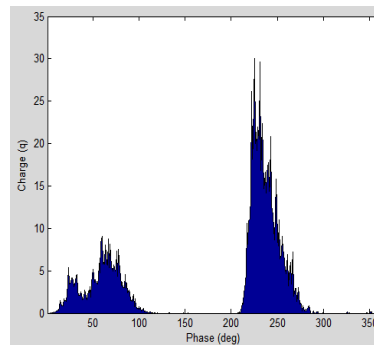


Fig.3(b).Phase plot (ϕ -q) of surface discharge

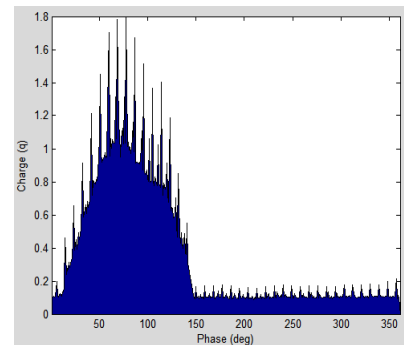


Fig.3(c). Phase plot (ϕ -q) of corona discharge

III.I.B Parameters of known PD patterns

TABLE I. PARAMETERS OF KNOWN PD PATTERNS

Parameter	void	surface	corona
Skewness $H_{qn}^+(\phi)$	1.0013	1.2134	0.3555
Skewness $H_{qn}^-(\phi)$	0.9901	1.8219	1.3659
Kurtosis $H_{qn}^+(\phi)$	2.9046	3.6064	2.4354
Kurtosis $H_{qn}^-(\phi)$	2.7872	5.4506	7.5947

III.I.C 2D distribution of (ϕ -q) for unknown PD patterns

Fig.4 (a), Fig.4 (b) and Fig.4 (c) are the phase ϕ vs. charge q plot for data1, data2 and data3 respectively.

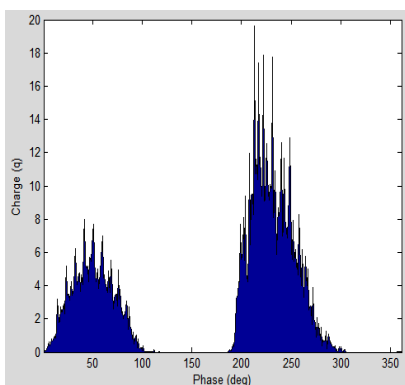


Fig.4 (a) Phase plot (ϕ -q) of data1

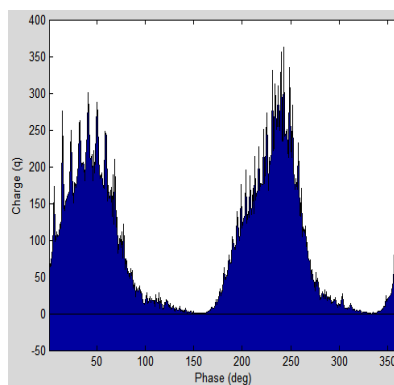


Fig.4 (b) Phase plot (ϕ -q) of data2

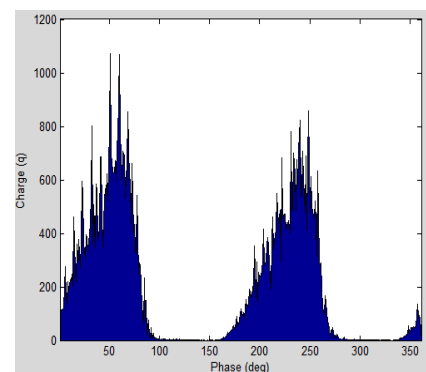


Fig.4 (c) Phase plot (ϕ -q) of data3

From Fig.4 (a), it is seen that the following plot is similar to void and surface discharge. Fig.4 (b), is also similar to void and surface discharge and Fig.4(c), is similar to void discharge.

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

III.I.D Parameters of unknown PD Patterns

TABLE II. PARAMETERS OF UNKNOWN PD PATTERNS

Parameter	data1	data2	data3
Skewness $H_{qn}^+(\varphi)$	0.8991	0.7456	1.0013
Skewness $H_{qn}^-(\varphi)$	1.1833	0.8509	0.9901
Kurtosis $H_{qn}^+(\varphi)$	2.5719	2.1814	2.9046
Kurtosis $H_{qn}^-(\varphi)$	3.7467	2.6512	2.7872

III.II Analysis for $(\varphi-n)$

The phase resolved $(\varphi-n)$ patterns consist of three known PD patterns: void, surface and corona (as discussed in 3.2.1) and three unknown PD patterns: data1, data2 and data3 (as discussed in 3.2.3) [9]. The plots are discussed below:

III.II.A Phase resolved plot $(\varphi-n)$ of known PD patterns

Fig.5 (a), Fig.5 (b) and Fig.5 (c) are the phase φ vs. number of pulses n for void, surface and corona discharges respectively.

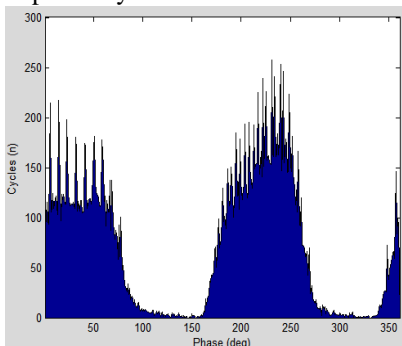


Fig.5(a).Phase plot $(\varphi-n)$ of void discharge

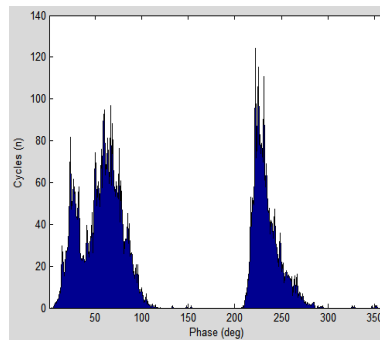


Fig.5(b).Phase plot $(\varphi-n)$ of surface discharge

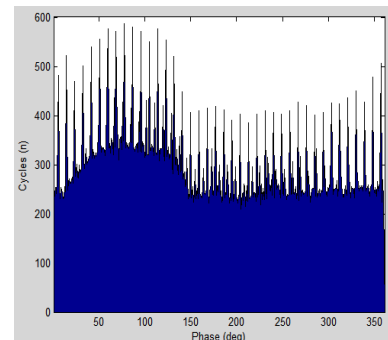


Fig.5(c).Phase plot $(\varphi-n)$ of corona discharge

III.II.B Parameters of unknown PD Patterns

TABLE III. PARAMETERS OF KNOWN PD PATTERNS

Parameter	void	surface	corona
Skewness $H_n^+(\varphi)$	0.4954	1.0082	1.3942
Skewness $H_n^-(\varphi)$	0.4329	2.3686	1.3798
Kurtosis $H_n^+(\varphi)$	2.0535	2.871	4.8337
Kurtosis $H_n^-(\varphi)$	1.9137	8.4788	7.3215

III.II.C. Phase resolved plot (ϕ -n) of unknown PD patterns

Fig.6 (a), Fig.6 (b) and Fig.6 (c) are the phase ϕ vs. number of pulses n plot for data1, data2 and data3 respectively.

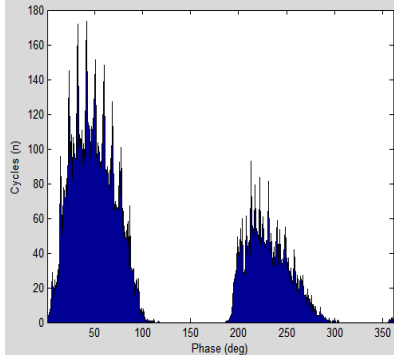


Fig.6(a).Phase plot (ϕ -n) of data1

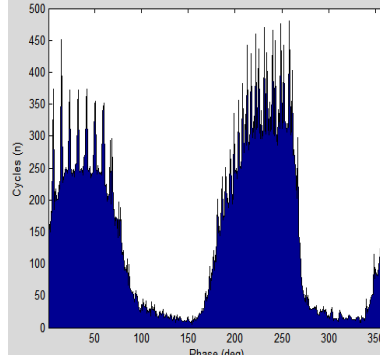


Fig.6(b).Phase plot (ϕ -n) of data2

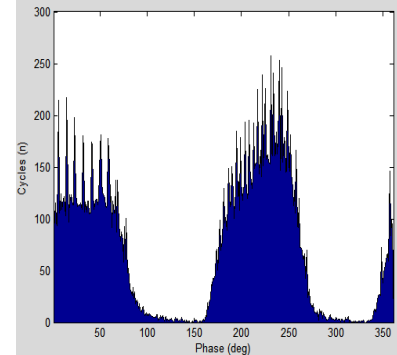


Fig.6(c).Phase plot (ϕ -n) of data3

From Fig.6 (a), it is seen that the following plot is similar to void and surface discharge. Fig.6 (b), is similar to void discharge and Fig.6 (c), is also similar to void discharge

III.II.D Parameters of unknown PD patterns

TABLE IV. PARAMETERS OF UNKNOWN PD PATTERNS

Parameter	data1	data2	data3
Skewness H_n^+ (ϕ)	0.8016	0.574	0.4954
Skewness H_n^- (ϕ)	1.0169	0.42	0.4329
Kurtosis H_n^+ (ϕ)	2.3724	2.1091	2.0535
Kurtosis H_n^- (ϕ)	3.2011	1.8003	1.9137

III.III Analysis for (n-q)

The phase resolved patterns n-q are obtained for three known PD patterns: void, surface and corona (as discussed in 3.3.1) and three unknown PD patterns: data1, data2 and data3 (as discussed in 3.3.3) [10].

III.III.A 2D distribution of n-q for known PD patterns

Fig. 7(a), Fig. 7(b), Fig. 7(c), Fig. 7(d) and Fig. 7(e) are the n-q plot of mean, standard deviation, variance, skewness and kurtosis for void discharge respectively.

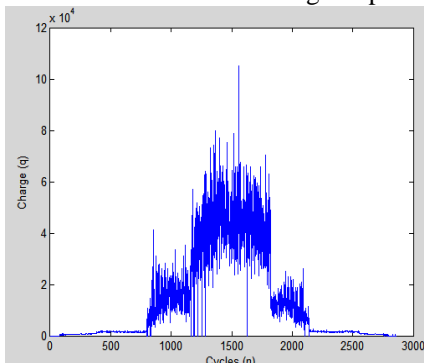


Fig.7(a).Mean plot (n-q) of void discharge

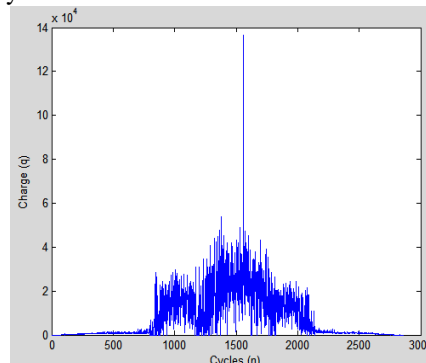


Fig.7(b).Standard deviation plot (n-q) of void discharge

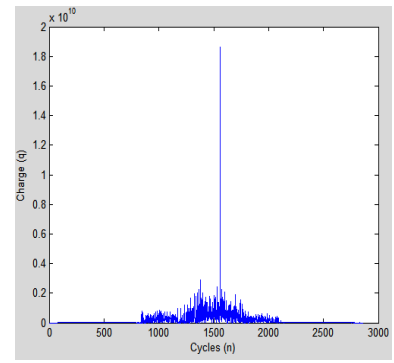


Fig.7(c).Variance plot (n-q) of void discharge

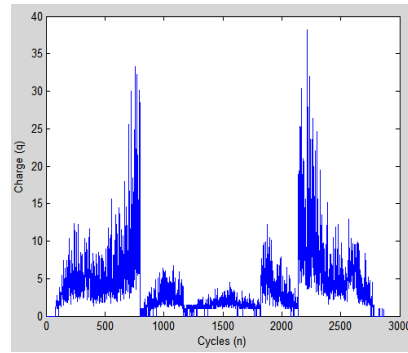
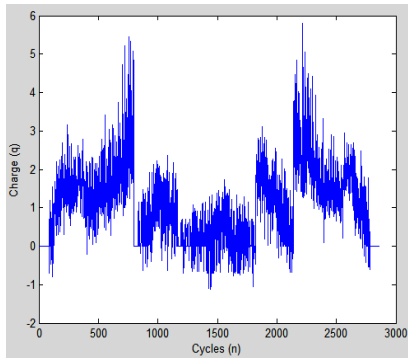


Fig.7 (d) Skewness plot (n-q) of void discharge **Fig.7 (e)** Kurtosis plot (n-q) of void discharge

Referring to Fig. 7 (a), Fig. 7 (b) and Fig. 7 (c) of void discharge, it can be seen there is a peak occurring somewhere after 1500 cycle, which is a void discharge and in Fig. 7 (d) and Fig. 7 (e) of skewness and kurtosis, the value decreases at that cycle where peak occurs.

Fig. 8(a), Fig. 8(b), Fig. 8(c), Fig. 8(d) and Fig. 8(e) are the n-q plot of mean, standard deviation, variance, skewness and kurtosis for surface discharge respectively.

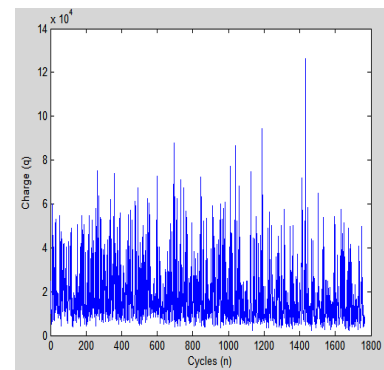
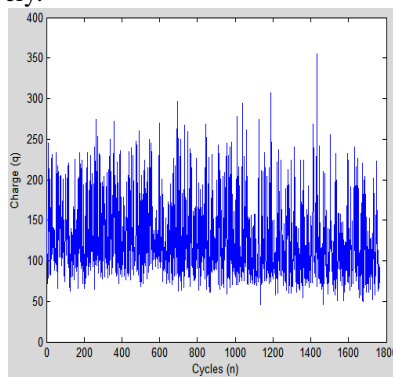
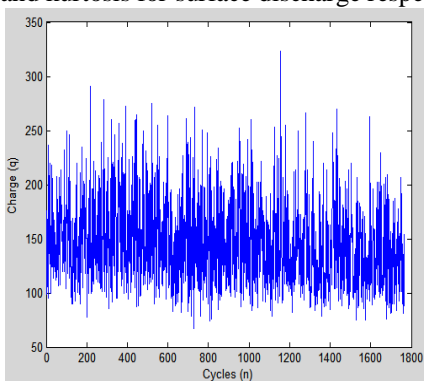


Fig.8 (a) Mean plot (n-q) of surface discharge

Fig.8 (b) Standard deviation plot (n-q) of surface discharge

Fig.8 (c) Variance plot (n-q) of surface discharge

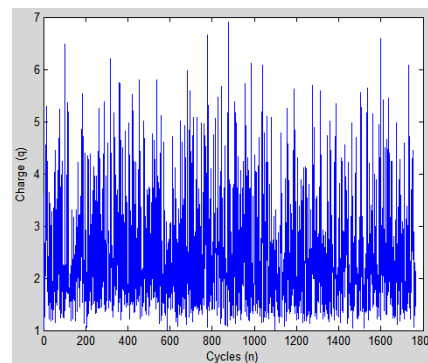
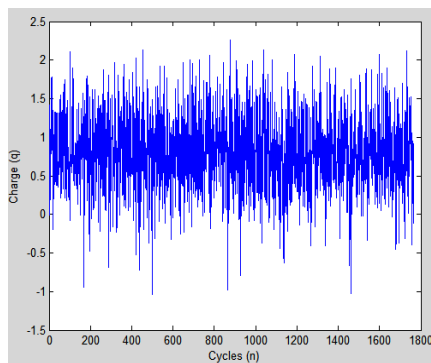


Fig.8 (d) Skewness plot (n-q) of surface discharge

Fig.8 (e) Kurtosis plot (n-q) of surface discharge

In surface discharge, charges are distributed uniformly over all cycles for mean, standard deviation, variance, skewness and kurtosis as shown in Fig. 8(a), Fig. 8(b), Fig. 8(c), Fig. 8(d) and Fig. 8(e).

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

Fig. 9(a), Fig. 9(b), Fig. 9(c), Fig. 9(d) and Fig. 9(e) are the n-q plot of mean, standard deviation, variance, skewness and kurtosis for corona discharge respectively.

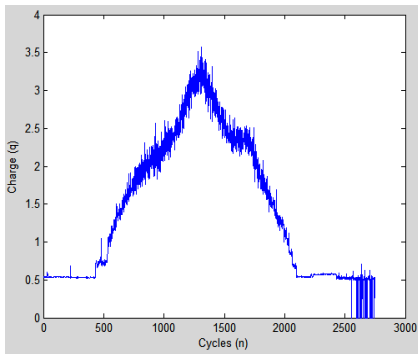


Fig.9 (a) Mean plot (n-q) of corona discharge

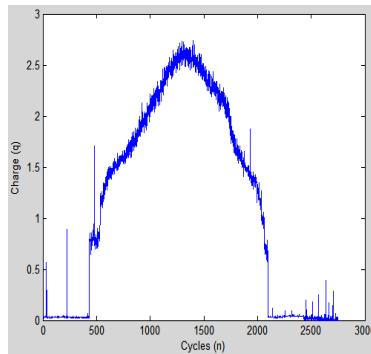


Fig.9 (b) Standard deviation (n-q) of corona discharge

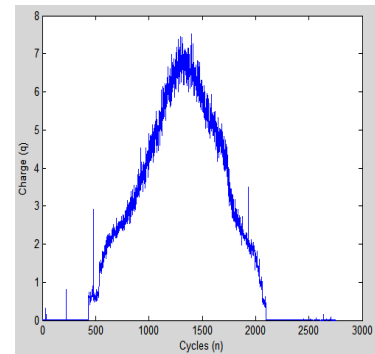


Fig.9 (c) Variance plot (n-q) of corona discharge

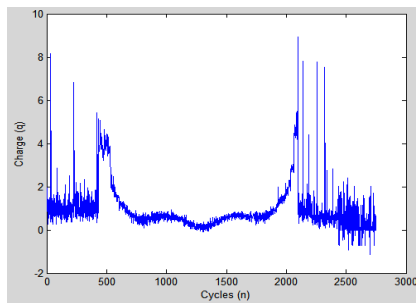


Fig.9 (d) Skewness plot (n-q) of corona discharge

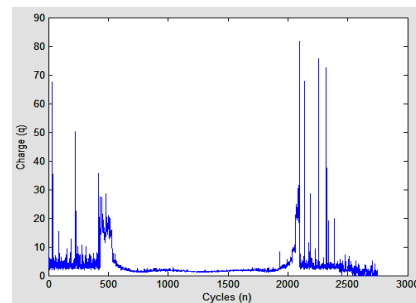


Fig.9 (e) Kurtosis plot (n-q) of corona discharge

Referring to Fig. 9(a), Fig. 9(b) and Fig. 9(c) of corona discharge, it can be seen the charges starts occurring after 500 cycle increasing somewhere upto 1200 cycle and then decreasing after 2000 cycle, and in Fig. 9(d) and Fig. 9(e) of skewness and kurtosis, the value decreases from 500 cycle till 2000 cycle.

III.III.B Parameters of known PD patterns

TABLE V. PARAMETERS OF KNOWN PD PATTERNS

Parameters	Void	Surface	Corona
Mean	13320.32	145.706	1.426
Standard deviation	7553.716	126.009	1.139
Variance	1.64×10^8	17921.01	2.279
Skewness	3.66×10^{-17}	0.809	0.26
Kurtosis	0.04878	2.442	0.966

III.III.C 2D distribution of (n-q) for unknown PD patterns

Fig. 10(a), Fig. 10(b), Fig. 10(c), Fig. 10(d) and Fig. 10(e) are the n-q plot of mean, standard deviation, variance, skewness and kurtosis for data1 respectively.

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

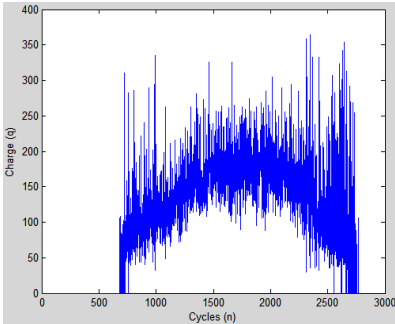


Fig.10 (a) Mean plot (n-q) of data1

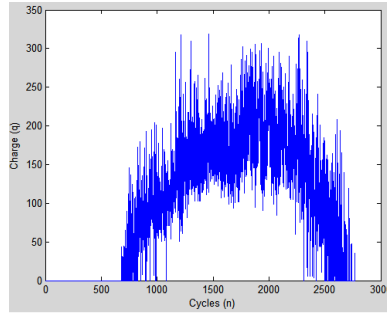


Fig.10 (b) Standard deviation plot (n-q) of data1

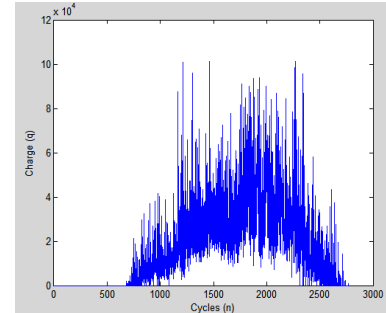


Fig.10 (c) Variance plot (n-q) of data1

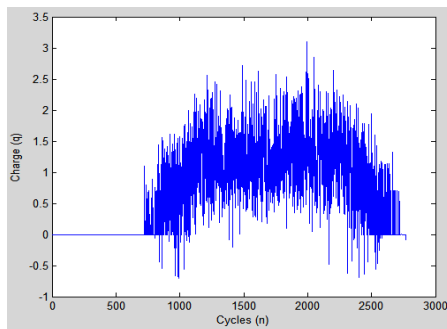


Fig.10 (d) Skewness plot (n-q) of data1

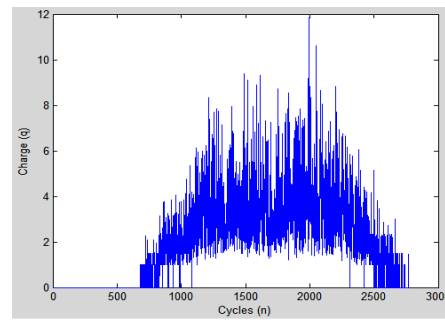


Fig.10 (e) Kurtosis plot (n-q) of data1

In Fig. 10(a), Fig. 10(b), Fig. 10(c), Fig. 10(d) and Fig. 10(e), the charges are uniformly distributed similar to surface discharge. Hence, it can be concluded that data1 is having surface discharge. Fig. 11(a), Fig. 11(b), Fig. 11(c), Fig. 11(d) and Fig. 11(e) are the n-q plot of mean, standard deviation, variance, skewness and kurtosis for data2 respectively.

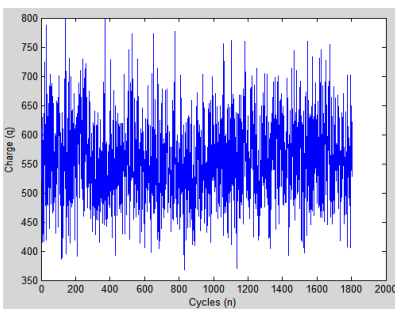


Fig.11 (a) Mean plot (n-q) of data2

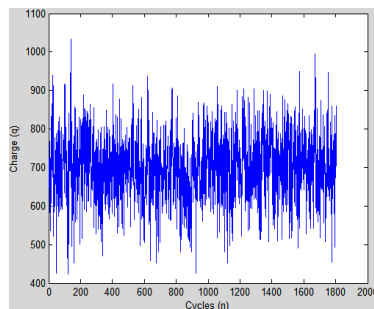


Fig.11 (b) Standard deviation plot (n-q) of data2

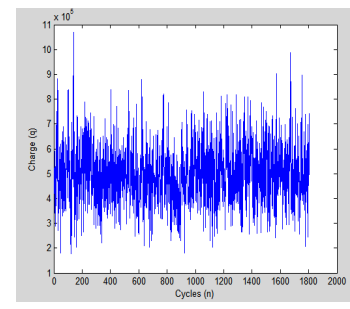


Fig.11 (c) Variance plot (n-q) of data2

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

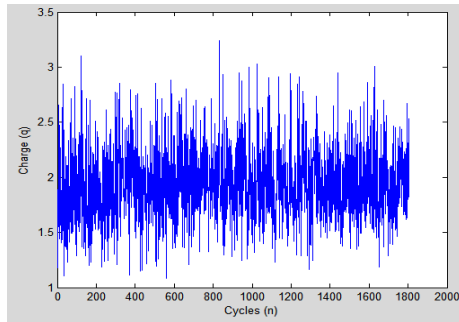


Fig.11 (d) Skewness plot (n-q) of data2

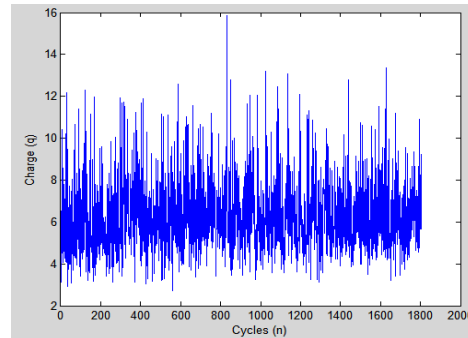


Fig.11 (e) Kurtosis plot (n-q) of data2

In Fig. 11(a), Fig. 11(b), Fig. 11(c), Fig. 11(d) and Fig. 11(e), the charges are uniformly distributed similar to surface discharge. Hence, it can be concluded that data2 is having surface discharge.

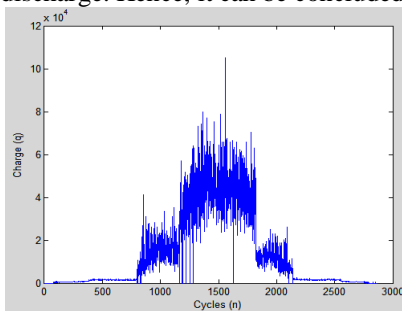


Fig.12 (a) Mean plot (n-q) of data3

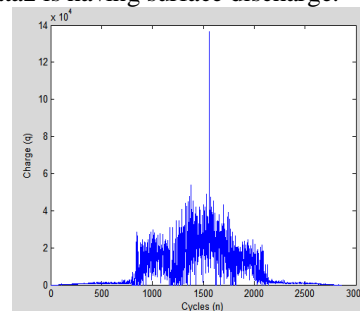


Fig.12 (b) Standard deviation plot (n-q) of data3

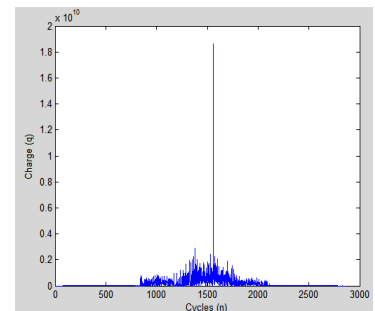


Fig.12 (c) Variance plot (n-q) of data3

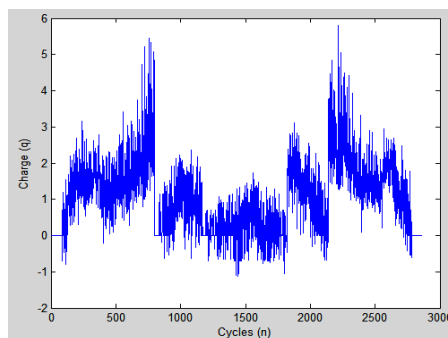


Fig.12 (d) Skewness plot (n-q) of data3

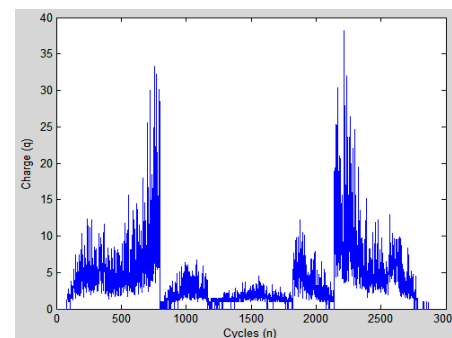


Fig.12 (e) Kurtosis plot (n-q) of data3

Fig. 12(a), Fig. 12(b), Fig. 12(c), Fig. 12(d) and Fig. 12(e) are the n-q plot of mean, standard deviation, variance, skewness and kurtosis for data3 respectively. In Fig. 12(a), Fig. 12(b) and Fig. 12(c), there is a occurrence of peak after 1500 cycle and in Fig. 12(d) and Fig. 12(e), the skewness and kurtosis value decreases at that peak which is similar to void discharge. Hence, it can be concluded that data3 is void discharge.

International Journal of Innovative Research in Science, Engineering and Technology

(An ISO 3297: 2007 Certified Organization)

Website: www.ijirset.com

Vol. 6, Issue 9, September 2017

III.III.D Parameters of unknown PD patterns

TABLE VI. PARAMETERS OF UNKNOWN PD PATTERNS

Parameters	data1	data2	data3
Mean	105.119	553.93	13320.32
Standard deviation	97.966	698.3	7553.716
Variance	16714.23	4.94×10^5	1.64×10^8
Skewness	0.692	1.939	-3.7×10^{-17}
Kurtosis	2.004	6.31	0.04878

IV. CONCLUSION

From all the above observations using all the three phase-resolved patterns(ϕ -q), (ϕ -n) and (n-q), it can be concluded that, data1 is surface discharge in all the three phase-resolved patterns, data2 is surface discharge in (n-q) pattern and void discharge in (ϕ -q) and (ϕ -n), hence data2 is both void and surface discharge and data3 is void discharge in all the three phase-resolved patterns.

REFERENCES

- [1] MICAMAXX™ plus – Partial Discharge Basics
- [2] M. G. Danikas, "The Definitions Used for Partial Discharge Phenomena," IEEE Trans. Elec. Insul., Vol. 28, pp. 1075-1081, 1993.
- [3] N.C. Sahoo, M. M. A. Salama, R. Bartnikas, "Trends in Partial Discharge Pattern Classification: A Survey", IEEE Transactions on Dielectrics and Electrical Insulation, Vol. 12, No. 2; April 2005.
- [4] E. Gulski, J. Smith, R. Brooks, "Partial Discharge Databases for Diagnosis Support of HV Components", IEEE Symposium on Electrical Insulation, pp. 424-427, 1998
- [5] E. Gulski and F. H. Kreuger, "Computer-aided recognition of Discharge Sources," IEEE Transactions on Electrical Insulation, Vol. 27 No. 1, February 1002.
- [6] E. Gulski and A. Krivda, "Neural Networks as a Tool for Recognition of Partial Discharges", IEEE Transactions on Electrical Insulation, Vol. 28 No.8, December 1993.
- [7] F. H. Kreuger, E. Gulski and A. Krivda, "Classification of Partial Discharges", IEEE Transactions on Electrical Insulation, Vol. 28 No. 6, December 1993.
- [8] C. Chang and Q. Su, "Statistical Characteristics of Partial Discharges from a Rod-Plane Arrangement"
- [9] Namrata Bhosale, Priyanka Kothoke Amol Deshpande, Dr. Alice Cheeran, "Analysis of Partial Discharge using Phase-Resolved(ϕ -q) and (ϕ -n) Statistical Techniques", International Journal of Engineering Research and Technology, Vol. 2 (05), 2013,ISSN2278-0181.
- [10] Priyanka Kothoke, Namrata Bhosale, Amol Deshpande, Dr. Alice Cheeran, "Analysis of Partial Discharge using Phase-Resolved (n-q) Statistical Techniques", International Journal of Engineering Research and Applications.

Proceedings papers:

1. Nur Fadilah Ab Aziz, L. Hao, P. L. Lewin, "Analysis of Partial Discharge Measurement Data Using a Support Vector Machine," The 5th Student Conference on Research and Development, 11-12 December 2007, Malaysia